


Location	Size & Type of Connection	
	A	B
1		
2		
3		
4		
5		
6		
7		
8		


Notes:

1. Pipe passage - notate which size of pipe you want to pass through the tank wall.
2. Flange - notate which size of MPT stainless steel connection is required.
3. Flanges cannot be installed in all 4 quadrants in the same tank.

Call factory for more direction.

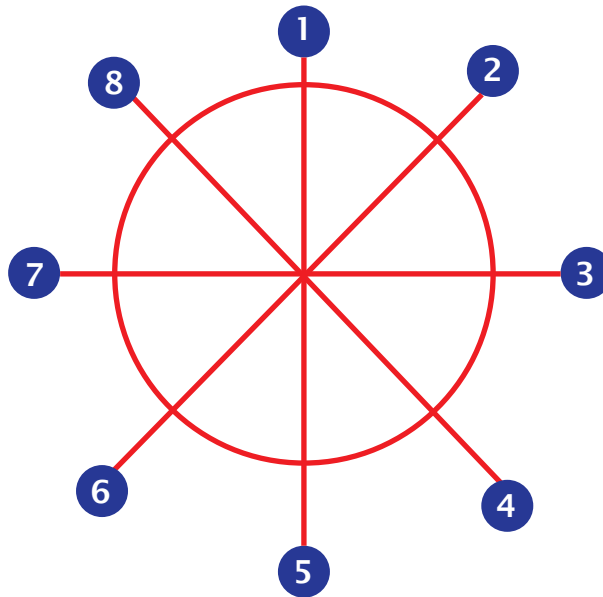

Top View

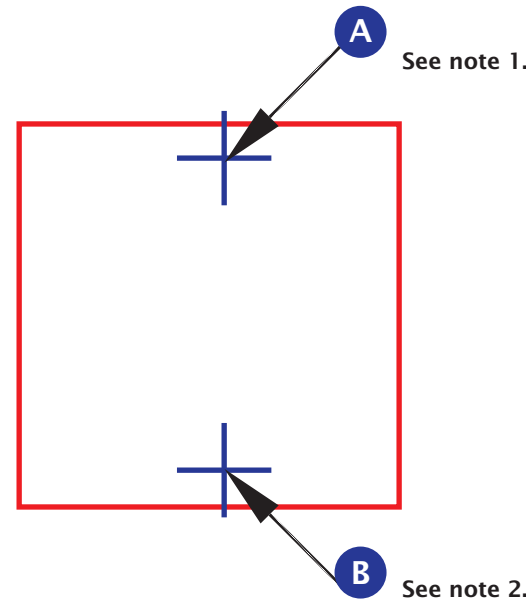

Side View

HYDROFLEX™
 WATER STORAGE TANKS
 855-268-3456
 info@hydroflexsystems.com
 www.hydroflexsystems.com